

# Photo



# Descriptions

Enables the use of wireless remote controller for ceiling suspended models.

# Applicable Models


- PCA-RP
- PCH-P

# Specifications

Operation indication	During operation: LED (green) is lit, Alarm: LED (green) flashes.
Emergency operation	Cooler/heater button (start/stop) is provided.
Number of units controlled	Max. 16 refrigerant systems per group (One or more wireless light receivers must be installed for each refrigerant system.)
Adapter wiring	9-wire cord (standard accessory) with connector is connected to the connector (CN90) on the indoor unit control board.
Light receiver range	7m or less, at within 45 degrees to the front of receiver (the range varies with conditions)
Operating conditions	Temperature: 0 to 40°C , Humidity: 30 to 90% (no condensation)
Exterior	White gray (Munsell 4.48Y 7.92/0.66), ABS resin
Installation method	Attached to the brand label case of indoor unit.
Accessory	Cord clip x 2

# Dimensions

Unit : mm

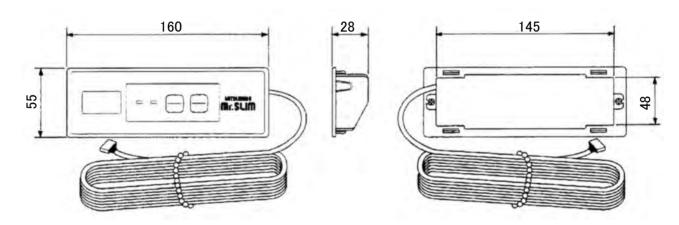

# How to Use / How to Install

# 1 Making Sure of Components

Make sure that the following components, along with this manual, are packed in the box.


Component	PAR-SL99B-E
Wireless remote controller	1
Receiver board	1
Remote control holder	1
"AAA" LR03 alkaline batteries	2
4.1x16 wood screws	2
Cord retaining clips	2
Connection cord fixing seal (12x30 size)	1

NOTE: The remote signal will reach the receiver over a distance of approx. 7 m in a straight line and approx. 45° left or right. If the infrared receiver is affected by fluorescent light (especially, inverter type), it may not be able to receive the signal. Take this into consideration when installing fluorescent lights or replacing them.


2 How to Install

### (1) Receiver board

- 1) Removing intake grille and right side panel
  - Slide the catch holding the intake grille backwards to open the grille. Remove the screw holding the side panel, and then slide the side panel forward to remove it.

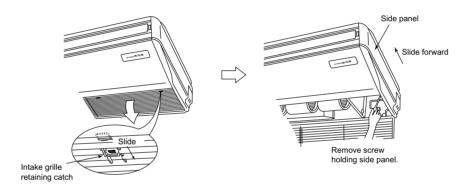


- 2 Removing existing brand label case
  - Remove the brand label case (name plate with characters Mr.SLIM) from the bottom right of unit. The brand label case is not needed. If it is difficult to remove the case, use a flat bladed screwdriver, etc., taking care that the panel is not damaged.




## 3 Installing receiver board


- Pass the receiver board connector through the right side of the square hole to which the brand label case was attached, and then pull the connector and cord through the slit in the right side of the bottom panel.
- Fit the infrared receiver into the square hole where the brand label case was attached.
- Use the connection cord fixing seal (provided) to block the slit in the right side of bottom panel so that the cord will not move

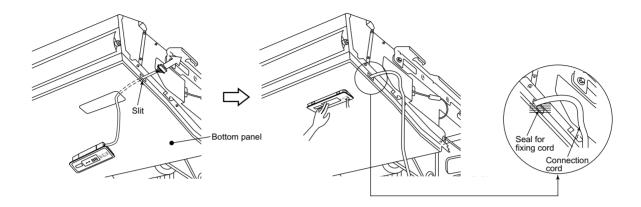


- 4 Attaching cord retaining clips and laying out cord
  - Insert the cord retaining clips into the holes  $(\Phi 5)$  in the bottom middle of the metal plate on the unit right side.
  - Using the clips to retain the cord, pass it through the retaining band and tighten the band.
  - Lay out the cord over the refrigerant pipe and pass it through the bush attached to the inner metal plate.

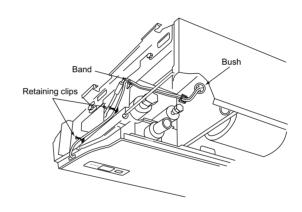

- 5 Removing beam and electrical parts cover
  - · Remove the beam.
  - Loosen the two screws at the bottom of electrical parts cover, and then slide the cover to the left to remove it.




- © Connecting receiver board connector to control circuit board.
  - Pass the cord through the bush at the top right of electrical parts case.
  - Connect the connector to CN90 on the right of the control board.
  - If the cord is loose, bundle it using the clamp under the above bush.
- ? Reinstalling removed components
  - Reinstall the removed components in reverse order.

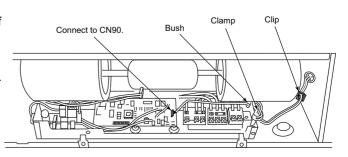

#### (2) Remote control holder

To install the wireless remote controller on a wall, first attach the remote control holder to a wall.



#### Fitting remote control into holder

- 1) Fix the remote control holder to the wall using the two wood screws provided.
- Insert the remote control into the holder.
- Push the remote control against the wall.

## Removing remote control


Pull the top of remote control forward.

#### 3 **Model Select**


This remote controller needs model number setting before use. Set the model number in the following order. Without setting the air conditioner will not work properly. (The factory setting of model number is "001".)

- 1 Insert batteries.
- 2 Press the SET button with something sharp at the end. MODE SELECT blinks and Model No. is lighted.
- ③ Press the temp () (a) button to set the Model No.
- 4 Press the SET button with something sharp at the end. MODE SELECT and Model No. are lighted for three seconds, then turned off.

Indoor	Outdoor	<ul> <li>Model No.</li> </ul>
PCH	PUH	001
PCA	PUH	001
	PUHZ	001
	SUZ	001
	PH	033



# **Test Run**



Measure an impedance between the power supply terminal block on the outdoor unit and the ground with a 500 V Megger and check that it is equal to or greater than 1.0 M  $\Omega$  .

- Turn on the main power to the unit.
   Press the button twice continuously. (Start this operation from the status of remote controller dispiay turned off.)
  - TEST RUN and current operation mode are displayed.
- ③ Press the MODE (♦♦♦□) button to activate COOL mode, then check
- whether cool air is blown out from the unit.


  ④ Press the MODE (♣♦♣♠₤) button to activate HEAT ⊕ mode, then check whether warm air is blown out from the unit.
- (5) Press the button and check whether strong air is blown out from the unit.
- MNE button and check whether the auto vane operates 6 Press the properly.
- The Press the ON/OFF button to stop the test run.

NOTE: • Point the remote controller towards the indoor unit receiver while following steps 2 to 7.

• It is not possible to run the in FAN, DRY or AUTO mode.

# 5 Pair Number Setting

- This is the setting to specify the unit to operate with the wireless remote controller.
- Make setting for J41, J42 (Jumper wire) of indoor controller board and the pair number of wireless remote controller.
- The pair number setting is available with the 4 patterns as shown in the <Table 2> from A to D. Make setting for the pair number (J41, J42) of indoor controller board and the pair number of wireless remote controller which is used as shown in the <Table 2>. \*The factory setting is pattern A.
  - ① Press the SET button with something sharp at the end. Start this operation from the status of remote controller display turned off.
    - MODEL SELECT blinks and Model No.is lighted.
  - ② Press the \_\_\_\_ button twice continuosly. pair No. "0" blinks.
  - 3 Press the temp 2 button to set the pair number you want to set .
  - Press the SET button with something sharp at the end. Set pair number is lighted for three seconds then turned off.



<ul> <li>Pair No. of wireless remote controller</li> </ul>	Indoor PC board
0	Factory setting
1	Cut J41
2	Cut J42
3 ~ 9	Cut J41, J42

## 6 Function Selection

【Changing the setting of the supply voltage for the indoor unit for A-control series.】 The setting of the supply voltage is done by the remote controller.

Be sure to change the power voltage setting depending on the voltage used.

- ① Go to the function select mode
  - Press the CHECK button f twice continuously.
  - (Start this operation from the status of remote controller display turned off.)
  - CHECK is lighted and "00" blinks.

Press the temp ① button • once to set "50". Direct the wireless remote controller toward the receiver of the indoor unit and press the button ⑥.

2 Setting the unit number

Press the temp 1 2 button 2 and 3 to set the unit number "00". Direct the wireless remote controller toward the receiver of the indoor unit and press the  $\overset{\min}{}$  button 8.

3 Selecting a mode

Enter 04 to change the power voltage setting using the 1 and 1 buttons. Direct the wireless remote controller toward the receiver of the indoor unit and press the  $\frac{1}{2}$  button R.

Current setting number:

1=1 beep (one second)

2=2 beeps (one second each)

3=3 beeps (one second each)

- ※ If a mode number that can not be recognized by the unit is entered, three beeps (3 beeps of 0.4 seconds duration) will be heard. Reenter the mode number selecting.
- ※ If the signal was not received by the sensor or an error occurred during transmission, you will not hear a beep or a "double beep" may be heard.

Press the button again.

4 Selecting the setting number

Use the 1 2 and 3 buttons to change the power voltage setting to 01 (240 V) .Direct the wireless remote controller toward the sensor of the indoor unit and press the \_\_\_\_\_ button 8.

the indoor unit and press the \_\_\_\_ button ♠.


→ At this time, current setting number for selected mode number will be output by the interrupted buzzer sounds and the blinks of operation indicator.


Output: setting number =  $1 \rightarrow \text{beep beep } (0.4 \text{ second} + 0.4 \text{ second}) \times 1$ 

 $2 \rightarrow \text{beep beep } (0.4 \text{ second} + 0.4 \text{ second}) \times 2$ 

 $3 \rightarrow \text{beep beep } (0.4 \text{ second} + 0.4 \text{ second}) \times 3$ 







 If a setting number that can not be recognized by the unit is entered, three beeps (3 beeps of 0.4 seconds duration) will be heard (nuit will beep only).

Reenter the setting number selecting.


※ If the signal was not received by the sensor or an error occurred during transmission, you will not hear a beep or a "double beep" may be heard.

Press the button again.

- ※ If the number that can not be set is input, the former setting number
  will be set.
- ⑤ To select multiple functions continuously Repeat steps ③ and ④ to change multiple function settings continuously.
- ⑥ Complete function selection Direct the wireless remote controller toward the sensor of the indoor unit and press the ③ button ⑥.

NOTE: Whenever changes are made to the function settings after construction or maintenance, be sure to record the added functions with an "O", in the "Check" column provided on the chart.





#### Other function selections

Now that you know how to change the power voltage setting, there are several other settings that can be changed as well. The following table lists the various settings that can be changed through the remote controller and the default settings.

Table 3

Function	Settings	PCA-RP-GA / PCH-P-GAH
Power failure automatic recovery	Not available	*1
	Available	*1
Indoor temperature detecting	Indoor unit operating average	0
	Set by indoor unit's remote controller	
	Remote controller's internal sensor	
LOSSNAY connectivity	Not supported	0
	Supported (indoor unit is not equipped with outdoor-air intake)	
	Not supported (indoor unit is not equipped with outdoor-air intake)	
Power voltage	240V	
	220V, 230V	0
Auto mode (only for PUHZ)	Energy saving cycle automatically enabled	0
	Energy saving cycle automatically disabled	
Filter sign	100Hr	
	2500Hr	0
	No filter sign indicator	
Fan speed	Quiet	
	Standard	0
	High ceiling	
No. of air outlets	4 directions	_
	3 directions	_
Installed options (high-performance filter)	Not supported	0
	Supported	
Up/down vane setting	No vanes	
· •	Equipped with vanes(No.1 set)	0
	Equipped with vanes(No.2 set)	
Energy saving air flow	Disabled	0
(Heating mode)	Enabled	
Humidifier	Not supported	0
(Direct Add-on type)	Supported	

<sup>\*1</sup> Power failure automatic recovery initial setting depends on the connecting outdoor unit.

## Things to remember when entering function selections:

The basic procedure for entering function selections is the same as described for switching between power voltages. However, there are some differences at step ② for selecting the unit number, step ③ for selecting the mode number and step ④ for selecting the setting number.

The following Tables (4) and (5) list the various function settings, mode numbers and setting numbers.

Table (2) details the functions of the entire refrigerant system while Table (5) shows the functions that can be set for the indoor unit.

Table 4. Itemized functions of the entire refrigerant system (select unit number 00)

Mode	Settings	Mode no.	Setting no.	Check	Remarks
Power failure	Not available	1			
automatic recovery	Available (Approximately 4-minutes wait-period after power is restored.)	01	2		Approx. 4-minute wait-period after power is restored.
Indoor temperature	Indoor unit operating average		1		
detecting	Set by indoor unit's remote controller	02	2		
	Remote controller's internal sensor		3		
LOSSNAY	Not Supported		1		
connectivity	Supported (indoor unit is not equipped with outdoor-air intake)	03	2		
	Not supported (indoor unit is equipped with outdoor-air intake)		3		
Power voltage	240V	0.4	1		
	220V, 230V	04	2		
Auto mode	Energy saving cycle automatically enabled	05	1		
(only for PUHZ)	Energy saving cycle automatically disabled	] 05	2		

Table 5. Itemized functions of the indoor unit (select unit numbers 01 to 03 or 07)

Mode	Settings	Mode no.	Setting no.	Check	Remarks
Filter sign	100Hr		1		
	2500Hr	07	2		
	No filter sign indicator		3		
Fan speed	Quiet		1		
	Standard	08	2		
	High ceiling		3		
No. of air outlets	Standard	00	1		
	High ceiling	09	2		
Installed options (high-performance filter)	Not supported	40	1		
	Supported	10	2		
Up/down vane	No vanes		1		
setting	Equipped with vanes(No.1 set)	11	2		
	Equipped with vanes(No.2 set)		3		
Energy saving air flow (Heating mode)	Disable	12	1		
	Enable	12	2		
Humidifier	Not supported	13	1		
(Direct Add-on type)	Supported		2		

## 2 Setting the unit numbers


Set "00" as the unit number when setting functions from Table 4.

When setting functions from Table 5:


- When setting functions for an indoor unit in an independent system, set the unit number to 01.
- · When setting functions for a simultaneous-Twin Triple indoor unit system, assign unit numbers from 01 to 03 to each indoor unit.
- · When setting the same functions for an entire simultaneous Twin Triple-indoor unit system, assign "07" as the unit number.
- 3 Selecting the mode number Select from Table 4 and Table 5.
- 4 Selecting the setting number.

#### 7 Self-Check


- ① Turn on the main power to the unit.
  ② Press the CHECK button twice continuously. (Start this operation from the status of remote controller display turned
  - A CHECK begins to light.
  - ® «00» begins to blink.
- ③ While pointing the remote controller toward the unit's receiver, press the button. The check code will be indicated by the number of times that the buzzer sounds from the receiver section and the number of blinks of the operation lamp.
- 4 Press the ON / OFF button to stop the self-check.



# Refer to the following tables for details on the check codes. [Output pattern A]



### [Output pattern B]



#### [Output pattern A] Errors detected by indoor unit

Wireless remote controller	Wired remote controller		
Beeper sounds/OPERATION INDICATOR lamp flashes (Number of times)	Check code	Symptom	Remark
1	P1	Intake sensor error	
2	P2, P9	Pipe (Liquid or 2- phase pipe) sensor error	
3	E6, E7	Indoor / outdoor unit communication error	
4	P4	Drain sensor error	1
5	P5	Drain pump error	]
6	P6	Freezing / Overheating safeguard operation	
7	EE	Communication error between indoor and outdoor units	
8	P8	Pipe temperature error	
9	E4	Remote controller signal receiving error	
10	_		
11	-	1	
12	Fb	indoor unit control system error (memory error,etc.)	
No sound		No corresponding	

## [Output pattern B] Errors detected by unit other than indoor unit (outdoor unit, etc)

Wireless remote controller	Wired remote controller		
Beeper sounds/OPERATION INDICATOR lamp flashes (Number of times)	Check code	Symptom	Remark
1	E9	Indoor/outdoor unit communication error (Transmitting error)(Outdoor unit)	
2	UP	Compressor overcurrent interruption	
3	U3, U4	Open / short of outdoor unit thermistors	
4	UF	Compressor overcurrent interruption (When compressor locked)	
5	U2	Abnormal high discharging temperature/49C worked/insufficient refrigerant	
6	U1,Ud	Abnormal high pressure (63H worked)/Overheating safeguard operation	
7	U5	Abnormal temperature of heat sink	For details, check the LED display
8	U8	Outdoor unit fan safeguard stop	of the outdoor controller board
9	U6	Compressor overcurrent interruption/Abnormal of power module	
10	U7	Abnormality of super heat dus to low discharge temperature	
11	U9,UH	Abnormality such as overvoltage or voltage shortage and abnormal synchronous signal to main circuit/Current sensor error	
12	_	-	
13	-	-	
14	Others	Other errors (Refer to the technical manual for the outdoor unit.)	

- \*1 If the beeper does not sound again after the initial two beeps to confirm the self-check start signal was received and the OPERATION INDICATOR lamp does not come on, there are no error records.
- \*2 If the beeper sounds three times continuously "beep, beep, beep (0.4+0.4+0.4 sec.)" after the initial two beeps to confirm the self-check start signal was received, the specified refrigerant address is incorrect.
- On wireless remote controller
   The continuous buzzer sounds from receiving section of indoor unit.
  - Blink of operation lamp

 On wired remote controller Check code displayed in the LCD.